INTER-LABORATORY COLLABORATIVE TEST : IM-14

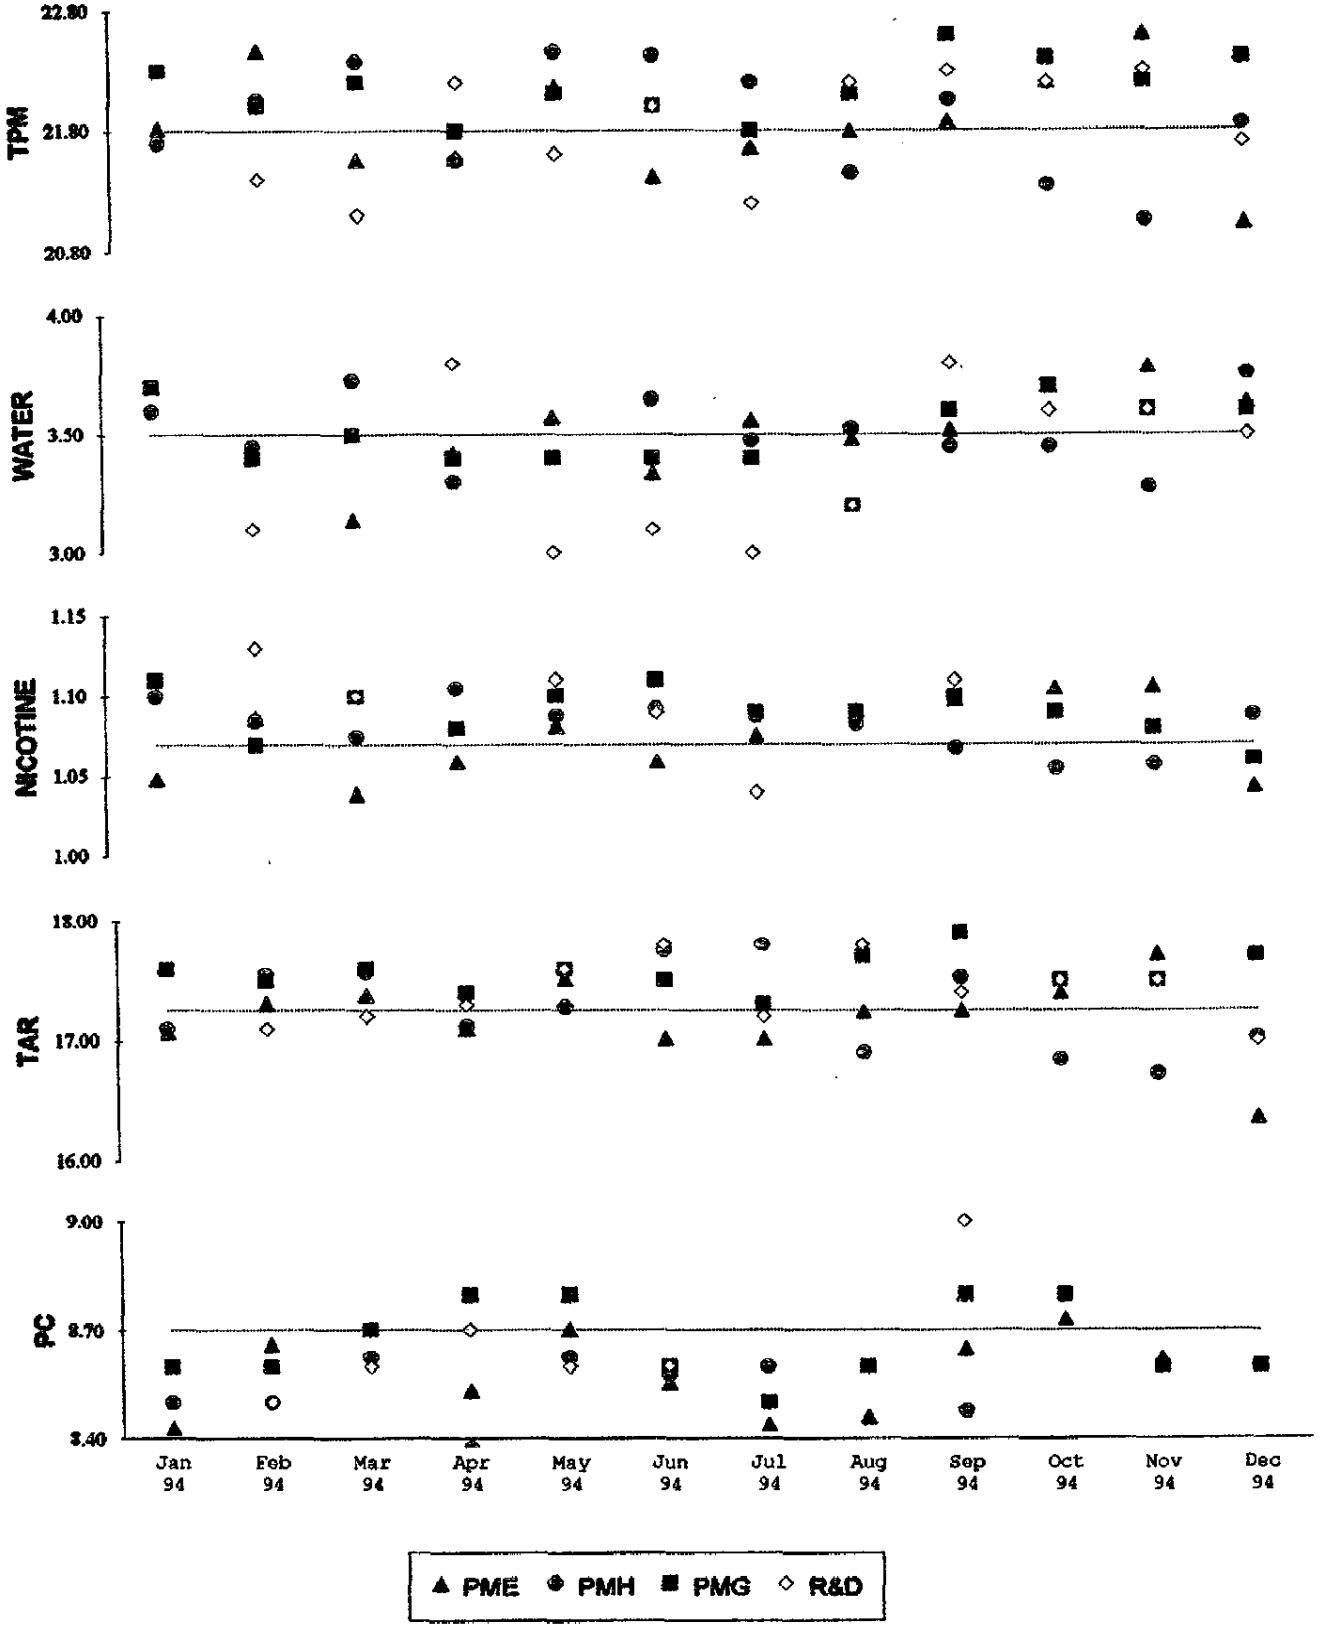

PM3000984809

Source: https://www.industrydocuments.ucsf.edu/docs/rtlk0001